

Merika® MekaPjk tap angle box

Mounting instructions


Merika no. 2237

- At installation of protective pipe lubricate the sealing in the bottom end of the box with a lubricant.
- Bracket the piping approx. 30 cm from the tap angle box.
- Test the PEX piping for pressure after the installation.
- Check the joints after the pressure test.
- After the pressure test, tighten and recheck the compression fittings.
- Use a straight fitting in the installation, e.g. Merika nr 1664.

In addition to this guide, the decrees 782/2017 on Humidity control performance and 814/2020 on Water supply and sewerage equipment of properties given by the Ministry of the Environment shall be followed.

We follow the terms of the Association of Technical Traders.

The connection work is always done by an HVAC professional.

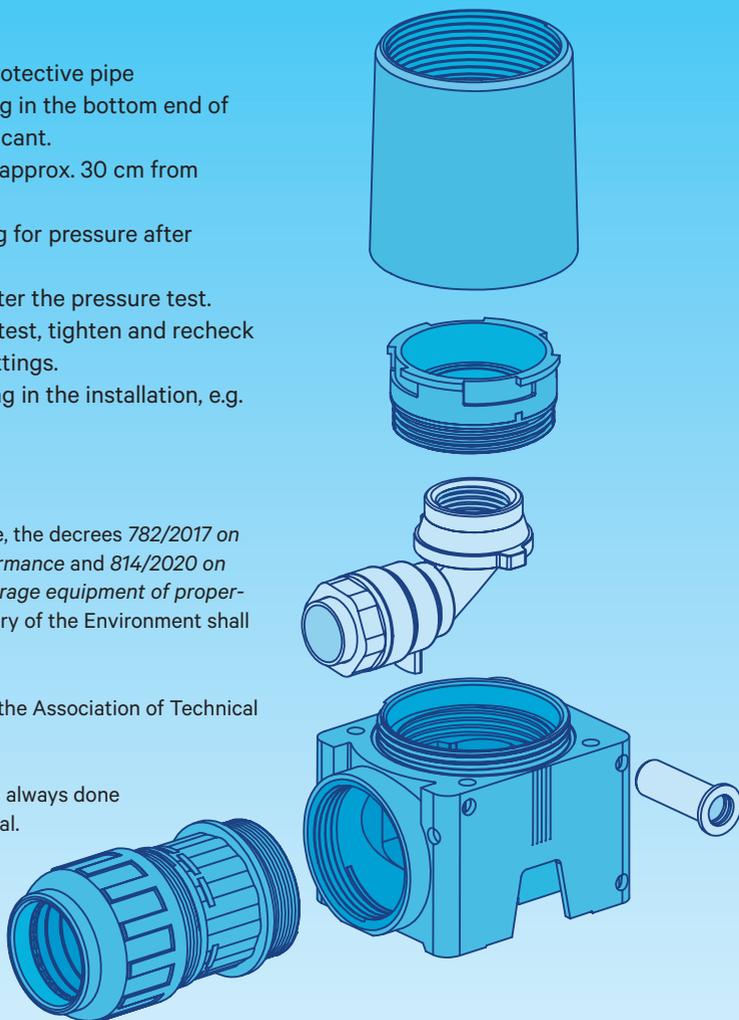

Installation phases


1.



2.



3.

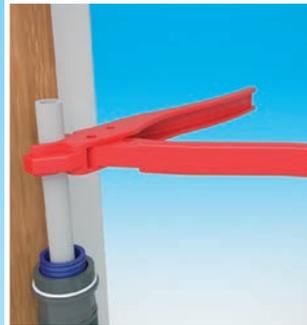

4.



5.



6.



7.



8.



9.



10.




11.



12.



13.

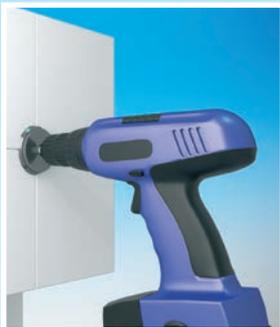

14.




15.



Merika 2237 MekaPjk tap angle box

Push Fit

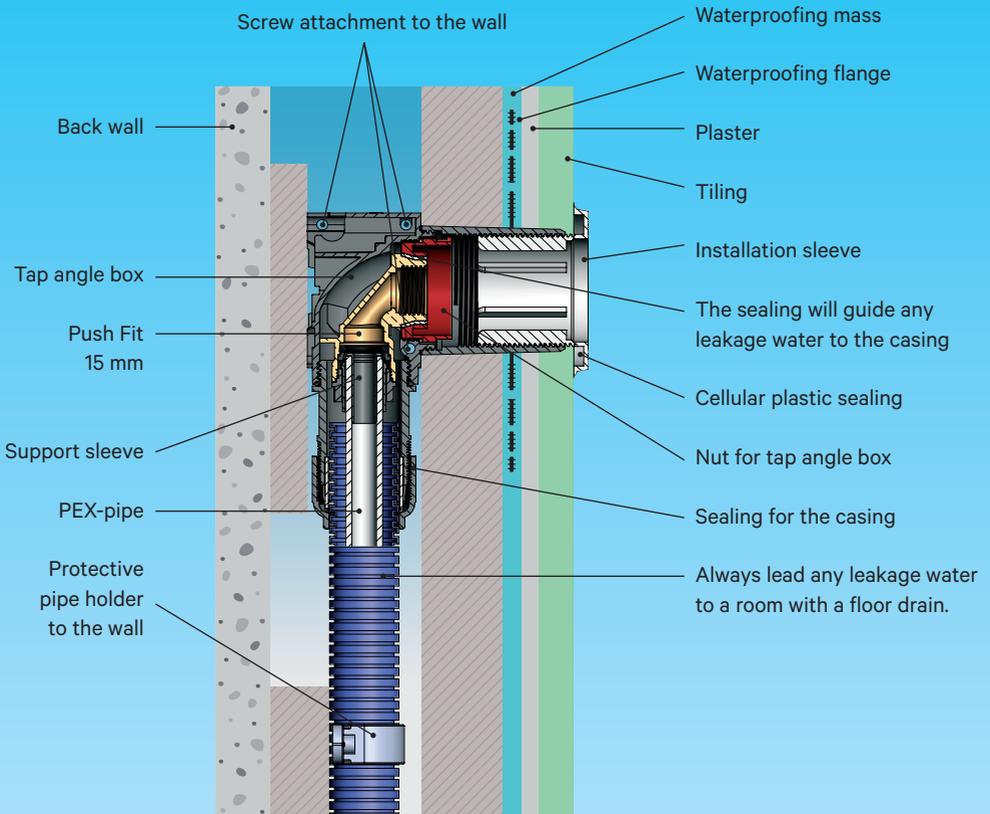

Accessories

- M-22862** MekaPjk pressure test plug ½" shallow, flush key hole 10 mm
- M-22372** MekaPjk pull-out tool for inner part
- M-22371** MekaPjk pull-out tool for inner nut
- M-22681** Merika cutter for tap angle box
- M-22692** Merika MekaPjk threaded sleeve
- M-23003** MekaPjk spacer 150 mm with libell

- M-23004** MekaPjk spacer 150 mm with libell and 32 HT angle
- M-23005** MekaPjk spacer 150 mm with libell and 50 HT angle
- M-22671** Merika MekaFit multitool
- M-23071** Merika waterproofing flange for a MekaPjk tap angle box
- M-226921** Internal angular bracket for sleeve of tap angle box



Meriser Oy
 Kauppatie 2, 29900 Merikarvia
 tel. +358 (0)207 189 810
 www.merika.fi, merika@meriser.fi



Quality for HVAC
 Technology

